


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

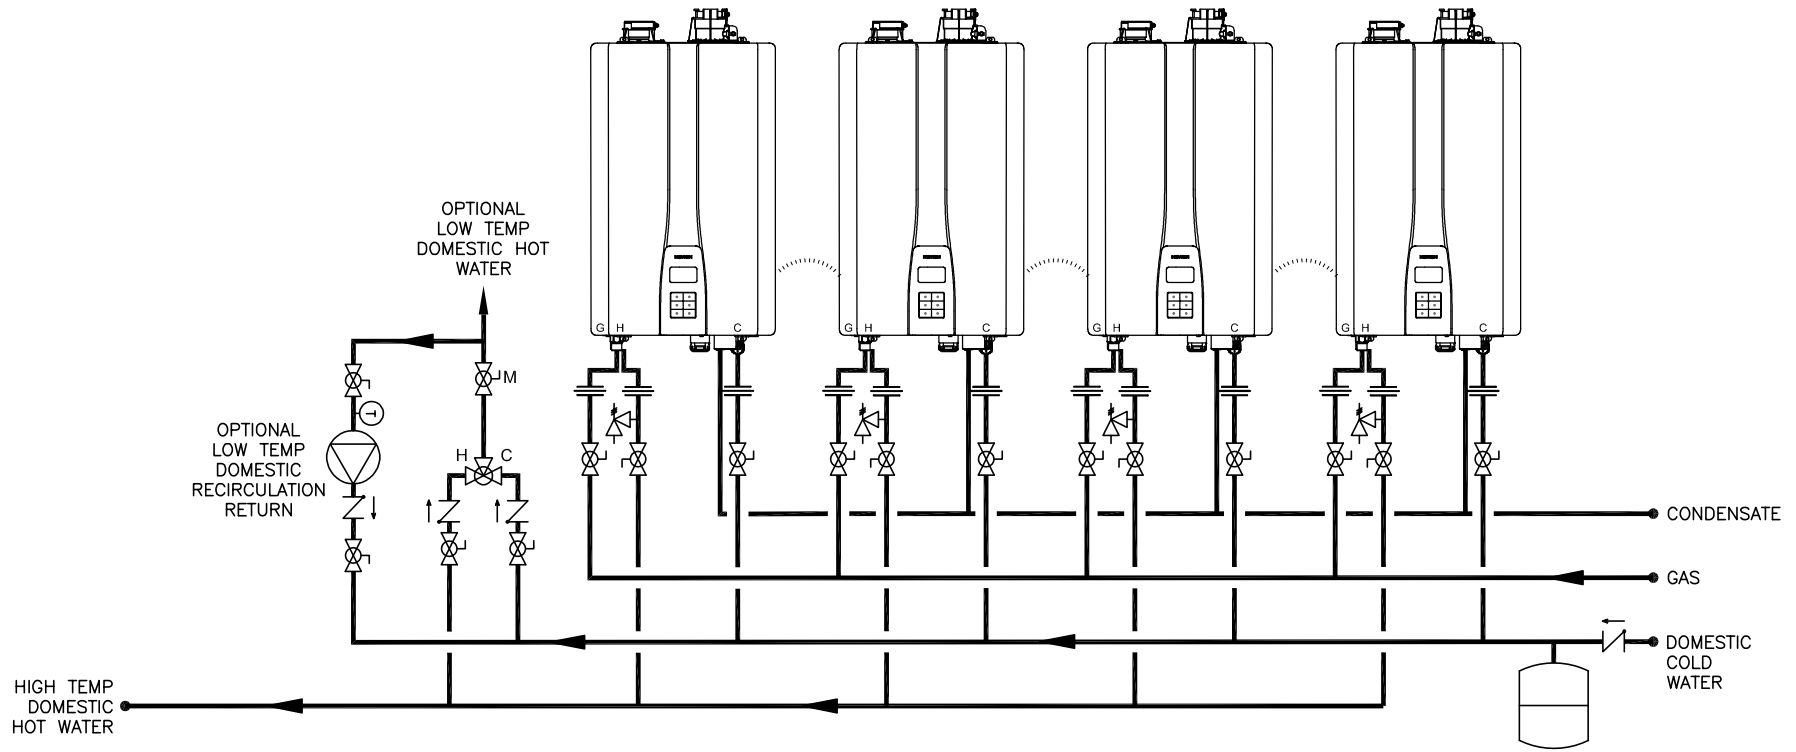

<p>20 GOODYEAR IRVINE, CA 92618 800-519-8794 www.navienc.com</p>	<p>TANKLESS QUANTITY: RECOMMENDED PIPE SIZE</p> <table border="1"> <tr> <td>1 UNIT: 3/4"</td> <td>2 UNITS: 1"</td> <td>3 UNITS: 1-1/4"</td> <td>4-5 UNITS: 1-1/2"</td> <td>6-8 UNITS: 2"</td> <td>9-14 UNITS: 2-1/2"</td> <td>15-16 UNITS: 3"</td> </tr> </table>						1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"	<p>SYMBOL LEGEND</p> <table border="1"> <tr> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> </tr> </table>															
	1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"																						
<p>(4) NPE-S2 SERIES TANKLESS WATER HEATER</p> <p>(4) NPE-S2 TANKLESS WATER HEATERS HIGH TEMP WITH THERMOSTATIC MIXING VALVE RECIRCULATION FOR LOW TEMP FIXTURES INCLUDES MODELS 150, 180, 210 AND 240</p>																													
<p>DRAWN BY: S. STOEKE</p>	<p>NPE-S2-4-EC-MV</p>			<p>MAY 11, 2022</p>																									