


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

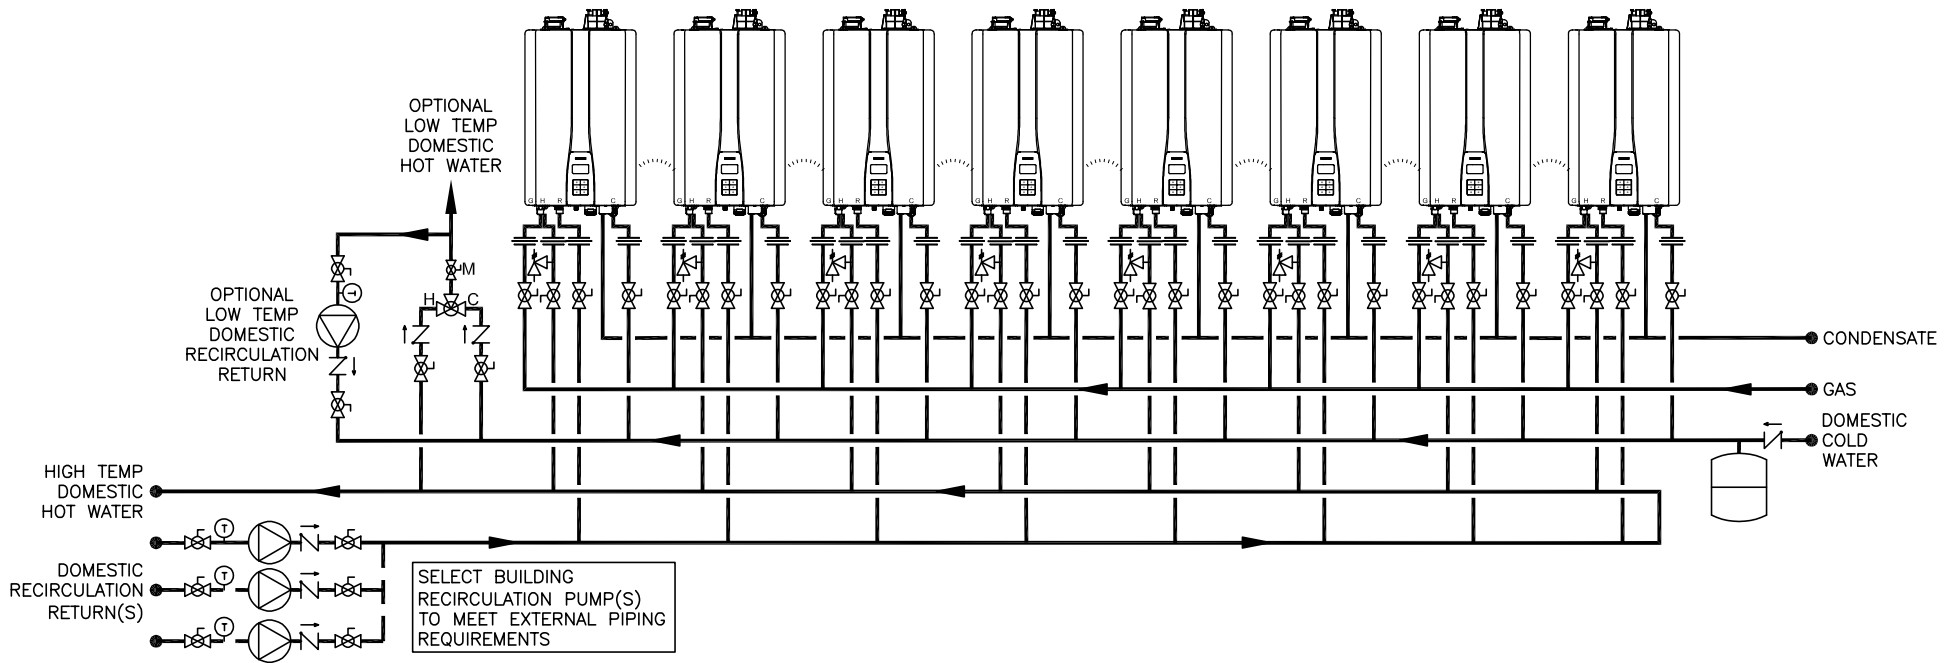

TANKLESS QUANTITY: RECOMMENDED PIPE SIZE

1 UNIT: 3/4" 2 UNITS: 1" 3 UNITS: 1-1/4" 4-5 UNITS: 1-1/2" 6-8 UNITS: 2" 9-14 UNITS: 2-1/2" 15-16 UNITS: 3"

SYMBOL LEGEND



20 GOODYEAR
IRVINE, CA 92618
800-519-8794
www.navienc.com

(8) NPE-A2 TANKLESS WATER HEATERS HIGH TEMP WITH THERMOSTATIC MIXING VALVE RECIRCULATION FOR LOW TEMP FIXTURES
INCLUDES MODELS 180, 210 AND 240

DRAWN BY:

S. STOEKE

NPE-A2-8-EC-MULT-MV

AUGUST 22, 2023



UNION



CHECK VALVE



FULL-PORT VALVE




EXPANSION TANK



CASCADE CABLE



PRESSURE RELIEF VALVE



MIXING VALVE



AQUASTAT



DHW CIRCULATOR W/ AQUASTAT, OPTIONAL TIMER & CHECK VALVE



CIRCULATOR