



Navien
Condensing Boilers

High Altitude Conversion Guide (NG Only)

Model

NFC-175
NFC-200

This boiler is configured for Natural Gas at the factory.

If the boiler is installed at a high altitude (above 5,400 ft) for NG, use the HIGH ALTITUDE CONVERSION KIT supplied with the boiler.

Note

- For NG high altitude conversion, use the HIGH ALTITUDE CONVERSION KIT.
- For LP high altitude conversion, use the LP CONVERSION KIT. Note that the Gas Orifice from the LP CONVERSION KIT covers the boiler's installation at an altitude of 0 to 10,100 ft.

WARNING

This conversion kit must be installed by a qualified service agency* in accordance with Navien's instructions and all applicable codes and requirements of the authority having jurisdiction. The information in these instructions must be followed to minimize the risk of fire or explosion or to prevent property damage, personal injury or death. The qualified service agency is responsible for the proper installation of this kit. The installation is not proper and complete until the operation of the converted appliance is checked as specified in the manufacturer's instructions supplied with the kit.

* A qualified service agency is any individual, firm, corporation or company which either in person or through a representative is engaged in and is responsible for the connection, utilization, repair or servicing of gas utilization equipment or accessories; who is experienced in such work, familiar with all precautions required, and has complied with all of the requirements of the authority having jurisdiction.

In Canada: The conversion shall be carried out in accordance with the requirements of the provincial authorities having jurisdiction and in accordance with the requirements of the CAN-B149.1 and CAN1-B149.2 Installation Code.

Tools Required:

- Phillips Screwdriver
- Flathead Screwdriver
- ⁵/₃₂ in or 4 mm Allen Wrench
- Combustion Analyzer or Dual Port Manometer
- Gas Leak Detector

Included Items:

WARNING

- Be careful not to confuse the LP CONVERSION KIT and HIGH ALTITUDE CONVERSION KIT. Do NOT use the HIGH ALTITUDE CONVERSION KIT for NG when converting to LP gas.
- Make sure that connections are made with the proper orifice. If the installed orifice does not conform to the specifications in Table 1, incomplete combustion may occur, resulting in personal injury or property damage.

- Gas Orifice (refer to below table)
- Gas Pressure and Conversion Kit Number Labels

NFC-175/200 Orifice Identification

Gas Type	NG	
	0-5,399 ft	5,400-10,100 ft
Orifice		
	NFC-200 NG Factory Installed	Ø6.3/Ø6.8 For High Altitude
Orifice Size	Ø6.1 / Ø6.6	Ø6.3 / Ø6.8

Table 1. Orifice Size

Procedure:

1. Turn off both gas and water supply to the boiler.
2. Unfasten the 4 latches (2 at the top and 2 at the bottom) to remove the front cover and gain access to the internal components. See Figure 1 for illustration of the front cover clamps.

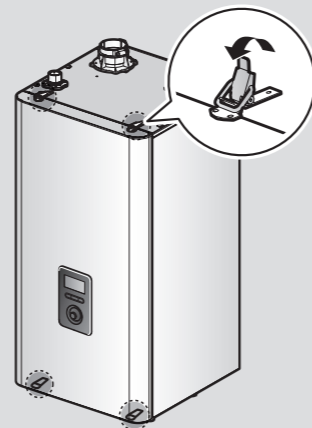


Figure 1. NFC Series Front cover

3. Remove the front cover and place it in a safe location to prevent accidental damage.

1 3
2 4

4. With the internal components exposed, locate the gas inlet pipe and the gas valve, as shown in Figure 2.

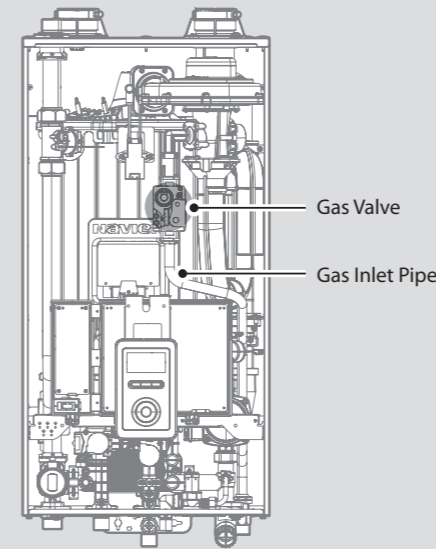


Figure 2. NFC Series Internal Components

5. Remove the clip at location A – the connection above the gas valve where it connects to the gas valve outlet adapter. See Figure 3 for reference.
6. Find location B - the connection above the gas valve where it is attached to the fan motor assembly. Carefully remove the four screws using a Phillips-head screwdriver and pull the gas valve outlet adapter away from the fan assembly to access the gas orifice.

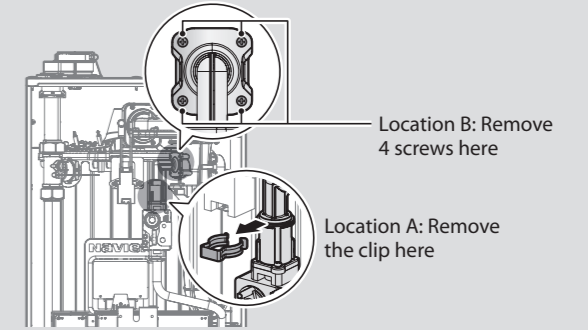


Figure 3. Detaching the Gas Valve Outlet Adapter from the Gas Valve and Fan Motor Assembly

7. Once the Gas Orifice is exposed, remove the two screws that hold the part in place. Remove the Gas Orifice from its housing and prepare the new Gas Orifice for the High Altitude conversion for installation.

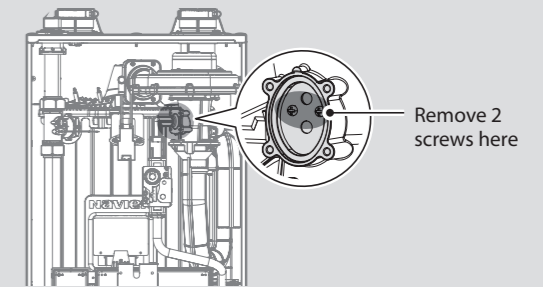


Figure 4. Access to Gas Orifice in Fan Assembly

WARNING

- DO NOT adjust or attempt to measure gas valve outlet pressure. The gas valve is factory-set for the correct outlet pressure. This setting is suitable for natural gas and propane, requiring no field adjustment.
- Attempting to alter or measure the gas valve outlet pressure could result in damage to the valve, causing potential severe personal injury, death or substantial property damage. Navien NFC boilers are shipped ready to fire natural gas ONLY.


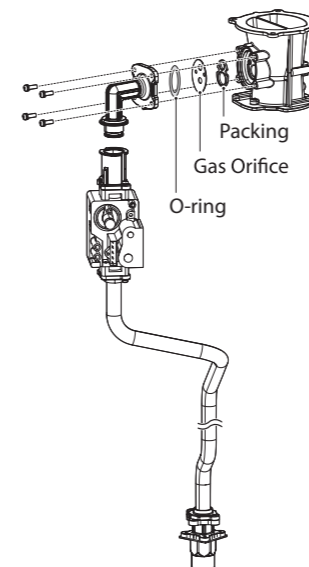


Figure 5. Exploded View of Gas Pipe Assembly

8. Remove the Gas Orifice, ensure that the packing is properly seated inside the port, and then install the new Gas Orifice for use with NG at a high altitude. Ensure that the Orifice is properly seated on the packing inside the port before proceeding to the next step.

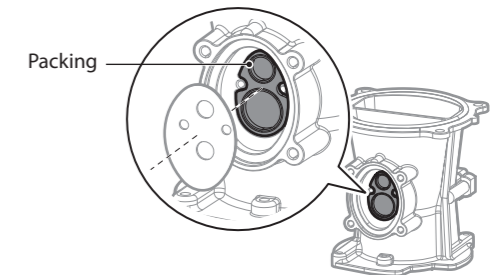


9. Replace the gas valve outlet adapter to its original position and use all screws to secure all connections.

Note Do not overtighten as this may damage or crack the components.

10. Set the PCB DIP switches by altitude according to the table in the warning below.

WARNING

Ensure that you have turned off the power to the boiler before accessing the DIP switches.

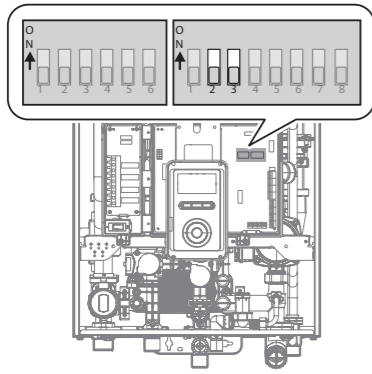

Switch	Function	Setting	
2&3	High Altitude	0-1,999 ft (0-609 m)	2-OFF, 3-OFF
		2,000-5,399 ft (610-1,645 m)	2-ON, 3-OFF
		5,400-7,699 ft (1,646-2,346 m)	2-OFF, 3-ON
		7,700-10,100 ft (2,347-3,078 m)	2-ON, 3-ON

Note Depending on high altitude settings, the orifice size used for the boiler varies. See Table 1 on the page 2 for details on orifice sizes.

- Note**
- This unit may be installed at elevations up to 10,100 ft (3,078 m) for use with natural gas and propane. To use the unit at a specific altitude, the DIP Switches should be set as described above.
 - High Altitude: Above 2,000 ft (610 m), the unit will de-rate by 3% for each 1,000 ft (305 m) of altitude gain.

DANGER

- For NG, use the Gas Orifice for high altitude when the boiler is installed at above 5,400 ft. Verify the proper orifice by checking the label on the part.
- Note that the Gas Orifice from the LP CONVERSION KIT covers the boiler's installation at an altitude of 0 to 10,100 ft.
- Failure to properly set the DIP switches could cause carbon monoxide poisoning, resulting in severe personal injury or death.

- Turn on the gas and water supply to the boiler.
- Measure and adjust the gas/air ratio.

Option 1. Using Combustion Analyzer (recommended)

- Loosen the screw, rotate the plate and remove the gasket to access the emissions monitoring port as shown in Figure 6.

b. Insert the analyzer into the port (Figure 6).

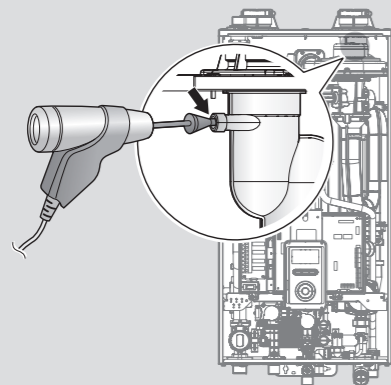


Figure 6. Insert the Analyzer

Model	Altitude	Fuel	High fire	Low fire
			%CO ₂	%CO ₂
NFC-175/200	0-5,399 ft	NG	8.9	9.5
		LP	10.2	10.8
	5,400-10,100 ft	NG	8.5	9.5
		LP	10.2	10.8

Table 2. CO₂ value
(CO₂ values must be within 0.5% of the values listed.)

- Activate multiple zones and set the boiler to operate at 1-stage MIN mode. Measure the CO₂ value at low fire. If the CO₂ value is not within 0.5% of the value listed in Table 2, the gas valve set screw will need to be adjusted. If adjustment is necessary, locate the set screw as shown in Figure 7. Using a ⁵/₃₂ in or 4 mm Allen wrench, turn the set screw no more than ¹/₄ turn clockwise to raise or counterclockwise to lower the CO₂ value.

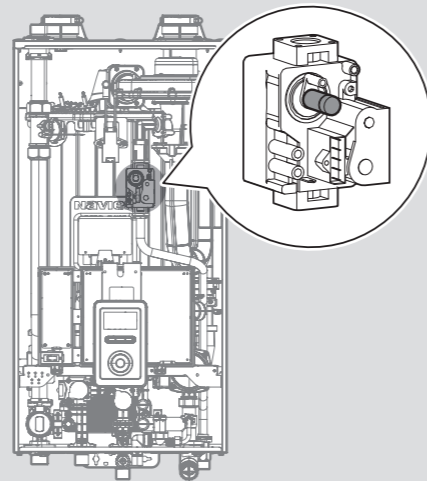


Figure 7. Set Screw Location

Note The set screw is located behind the screw-on cover. This must be removed first.

- Activate multiple zones and set the boiler to operate at 2-stage D. MAX mode. Measure the CO₂ value at high fire. If the CO₂ values do not match Table 2 at high fire, do not adjust the gas valve. Check for the proper Gas Orifice.

DANGER

Improper gas valve settings can cause severe personal injury, death or substantial property damage.

Option 2. Using Digital Manometer

- Open the offset pressure port by loosening the screw two turns as shown in Figure 8.

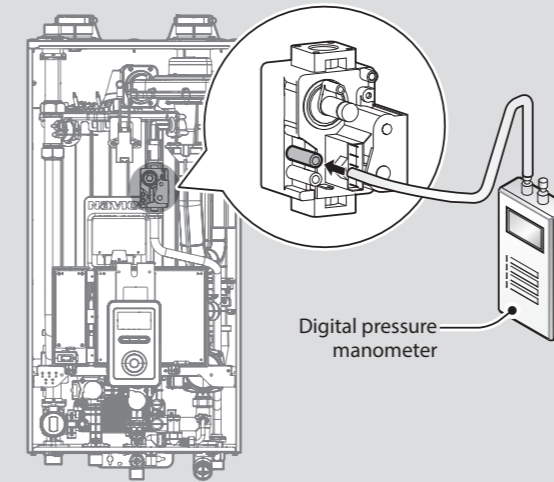


Figure 8. Connect Digital Pressure Monometer

- Connect a manometer to the offset pressure port. For dual port manometers, use the positive pressure side.

Model	Kit Part No.	Gas Type	Offset
NFC-175/200	NAC-NCH200	NG	-0.04 in ±0.01 in
	NAC-LC200	LP	-0.02 in ±0.01 in

Table 3. Offset value for low fire

- Activate multiple zones and set the boiler to operate at 1-stage MIN mode. Measure the offset value at low fire and compare it to the values in Table 3. If the offset value is out of range, the gas valve set screw will need to be adjusted.

If adjustment is necessary, locate the set screw as shown in Figure 9. Using a ⁵/₃₂ in or 4mm Allen wrench, turn the set screw no more than ¹/₄ turn clockwise to raise or counterclockwise to lower the offset value.

5 7
6 8

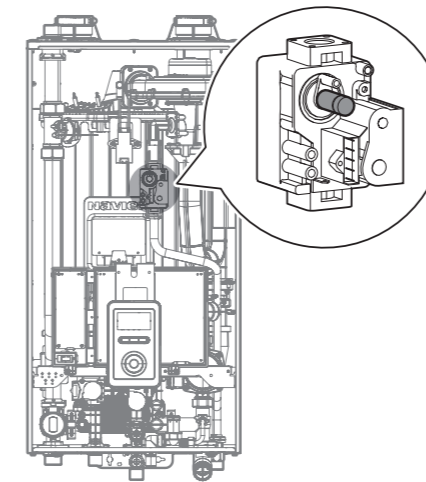


Figure 9. Set Screw Location

Note The set screw is located behind the screw-on cover. This must be removed first.

- At high fire, do not check the offset value and never adjust the gas valve.

DANGER

Improper gas valve settings can cause severe personal injury, death or substantial property damage.

- Once the CO₂ or offset values have been confirmed, apply the included conversion stickers to show that the appliance has been converted to High Altitude. Place these labels adjacent to the rating plate as shown in Figure 10.

<p>This unit has been Converted to High Altitude / Cet appareil a été converti au Haute altitude</p> <p>Orifice Size / Injecteur: Min, 6,3 mm to Max, 6,8 mm</p> <p>Inlet Gas Pressure / Pression d'entrée du gaz: Min, 8,0 to Max 13,0 inches WC</p> <p>Manifold Gas Pressure / Pression à la tubulure d'alimentation: -0,20 inches WC</p> <p>BTU Input / Débit calorifique: Max, 199,900 - Min, 18,000 BTU/h</p> <p>Conversion Kit No. : NAC - NCH200</p>	<p>This unit was converted on _____(day)_____(month)_____(year)</p> <p>to _____ gas with Kit No. _____</p> <p>by _____</p> <p><small>(name and address of organization making this conversion, who accepts the responsibility for the correctness of this conversion)</small></p>
---	---

Figure 10. Proper Placement of High Altitude Conversion Labels

Note The gas conversion rating plate varies depending on the model. Check the conversion kit number before attaching the labels.



Navien, Inc.
20 Goodyear Irvine, CA 92618
TEL 1-800-519-8794 FAX 1-949-420-0430
www.navien.com